


LINE TABLE		
LINE	BEARING	DISTANCE
L1	S 50°46'12" W	22.00'
L2	N 32°12'18" W	27.13'

CURVE TABLE						
CURVE	LENGTH	RADIUS	TANGENT	CHORD	BEARING	DELTA
C1	151.71'	297.50'	77.54'	150.07'	S 53°27'10" E	29°13'03"
C2	26.90'	237.50'	13.47'	26.89'	S 64°48'56" E	6°29'26"

DEMOLITION KEYNOTES:

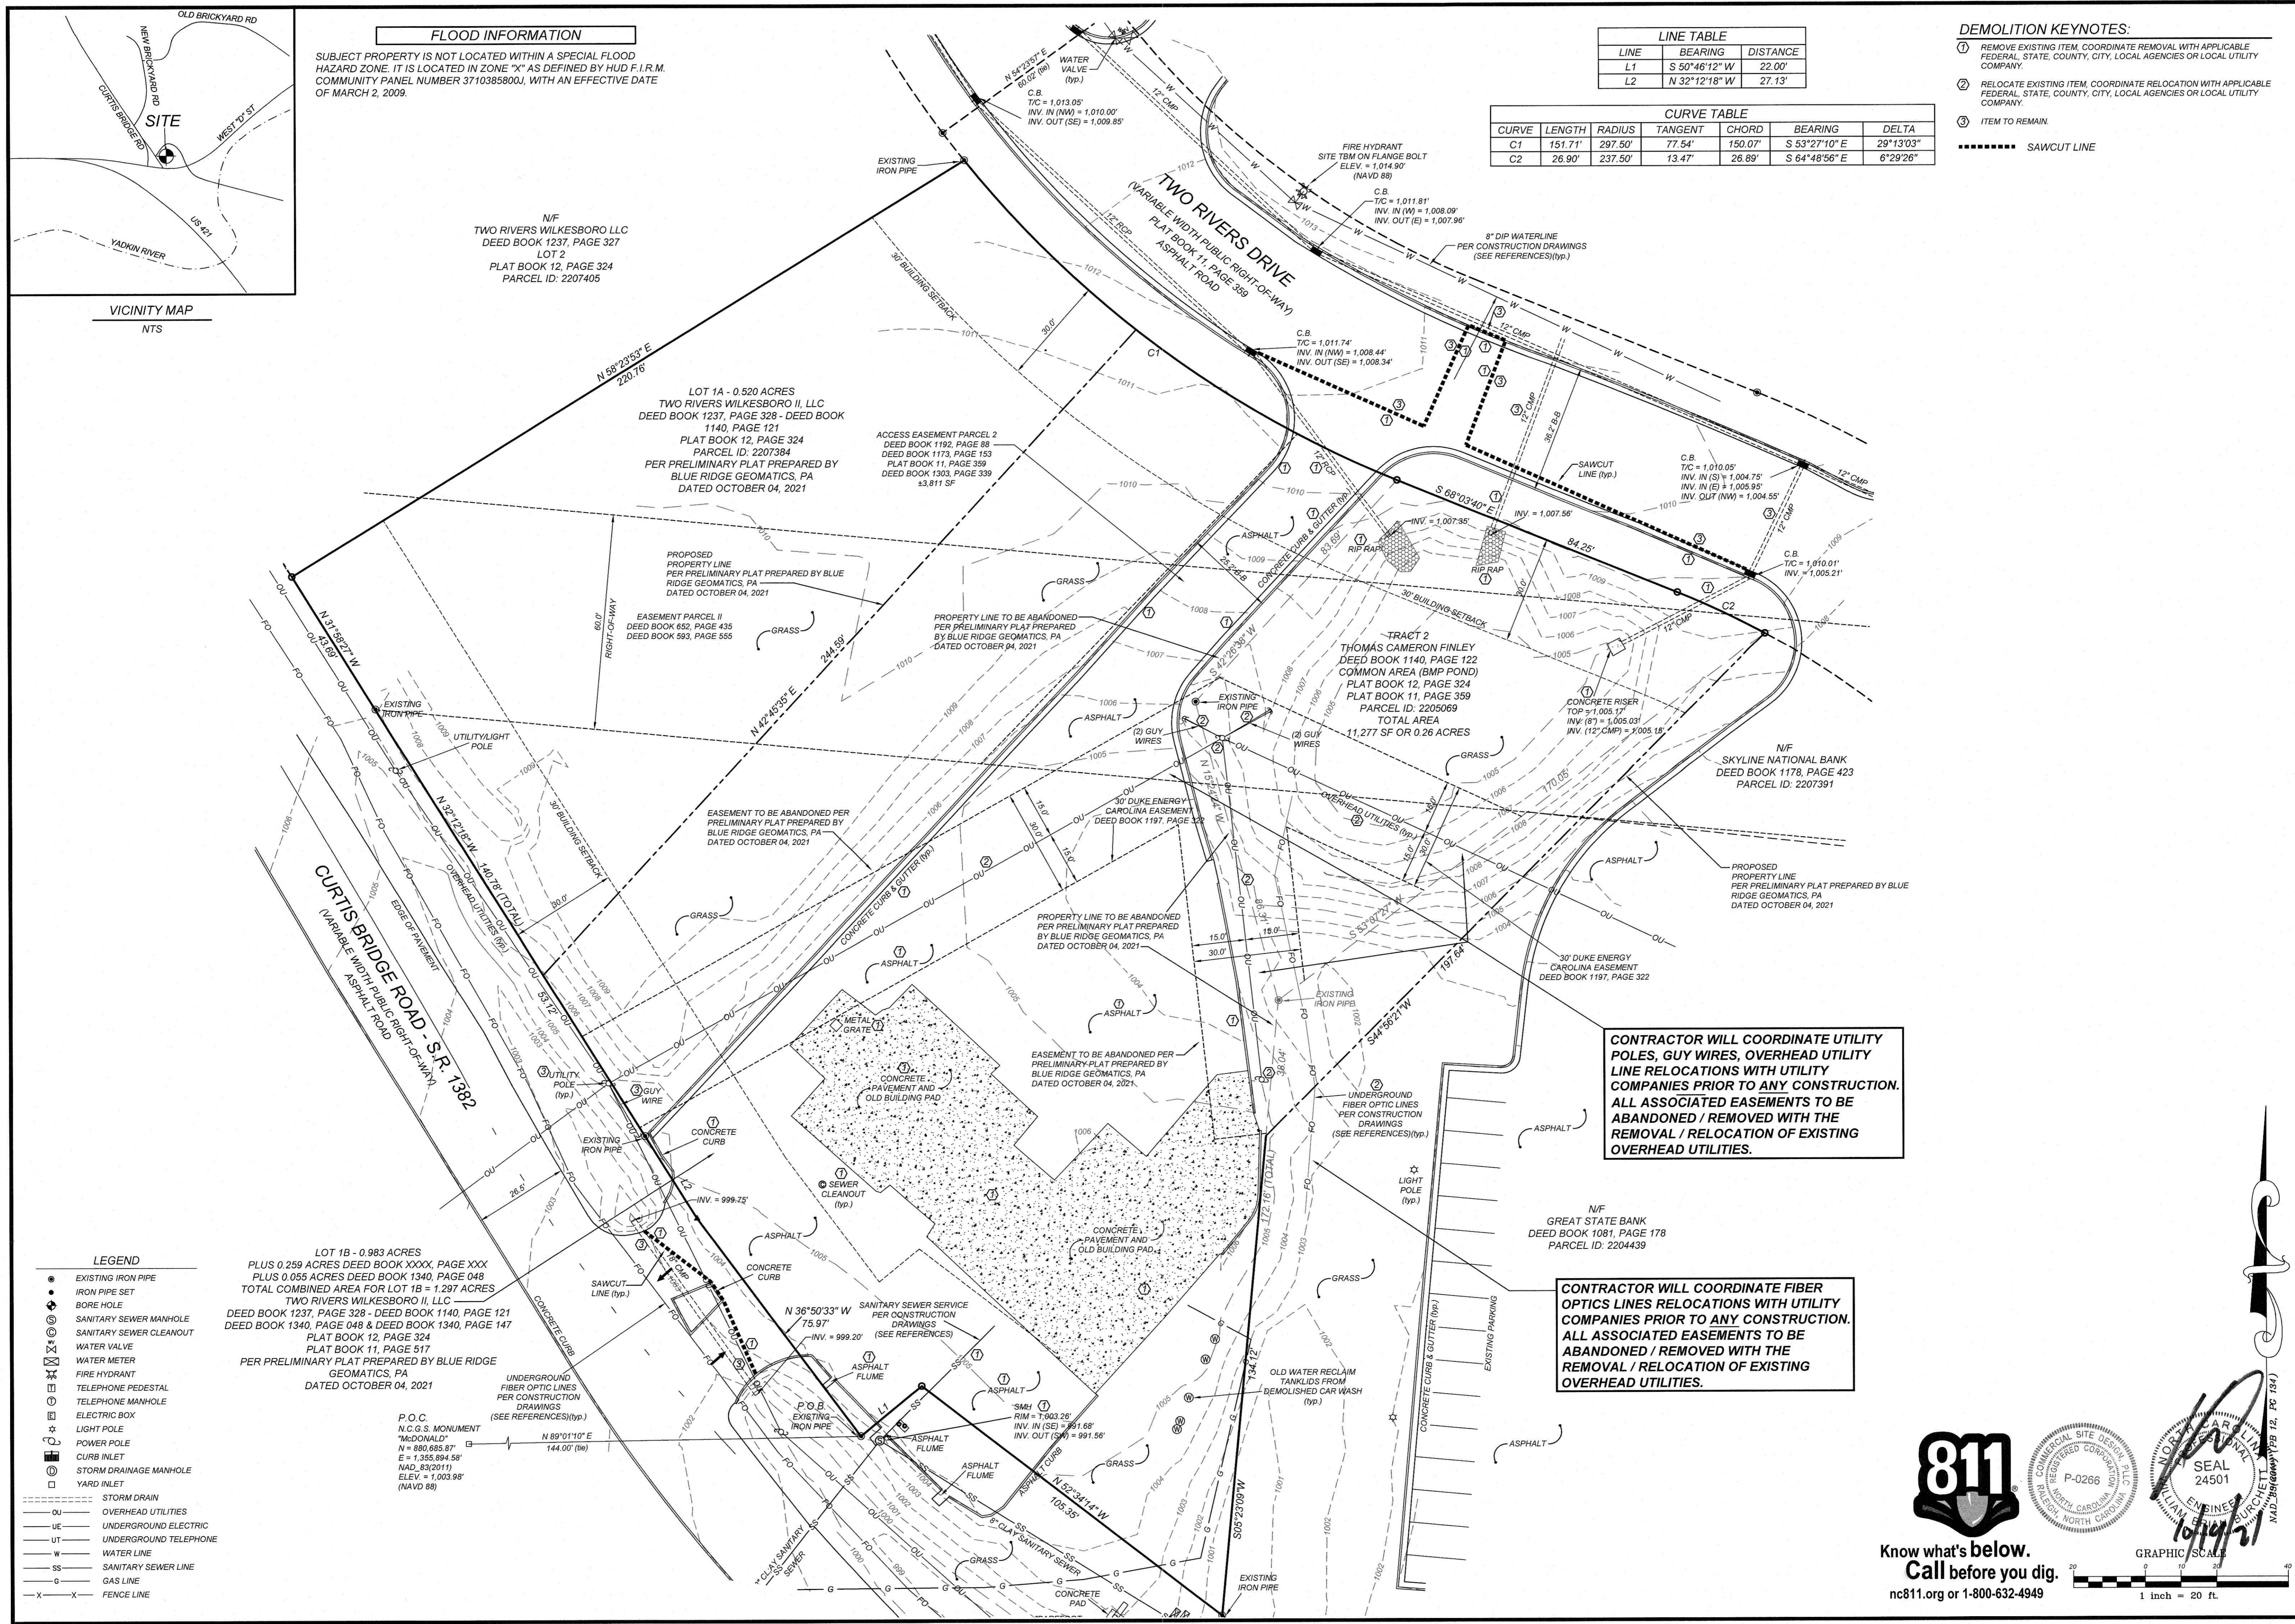

**CONTRACTOR WILL COORDINATE UTILITY  
POLES, GUY WIRES, OVERHEAD UTILITY  
LINE RELOCATIONS WITH UTILITY  
COMPANIES PRIOR TO ANY CONSTRUCTION.  
ALL ASSOCIATED EASEMENTS TO BE  
ABANDONED / REMOVED WITH THE  
REMOVAL / RELOCATION OF EXISTING  
OVERHEAD UTILITIES.**

**CONTRACTOR WILL COORDINATE FIBER OPTICS LINES RELOCATIONS WITH UTILITY COMPANIES PRIOR TO ANY CONSTRUCTION. ALL ASSOCIATED EASEMENTS TO BE ABANDONED / REMOVED WITH THE REMOVAL / RELOCATION OF EXISTING OVERHEAD UTILITIES.**

[illegible]