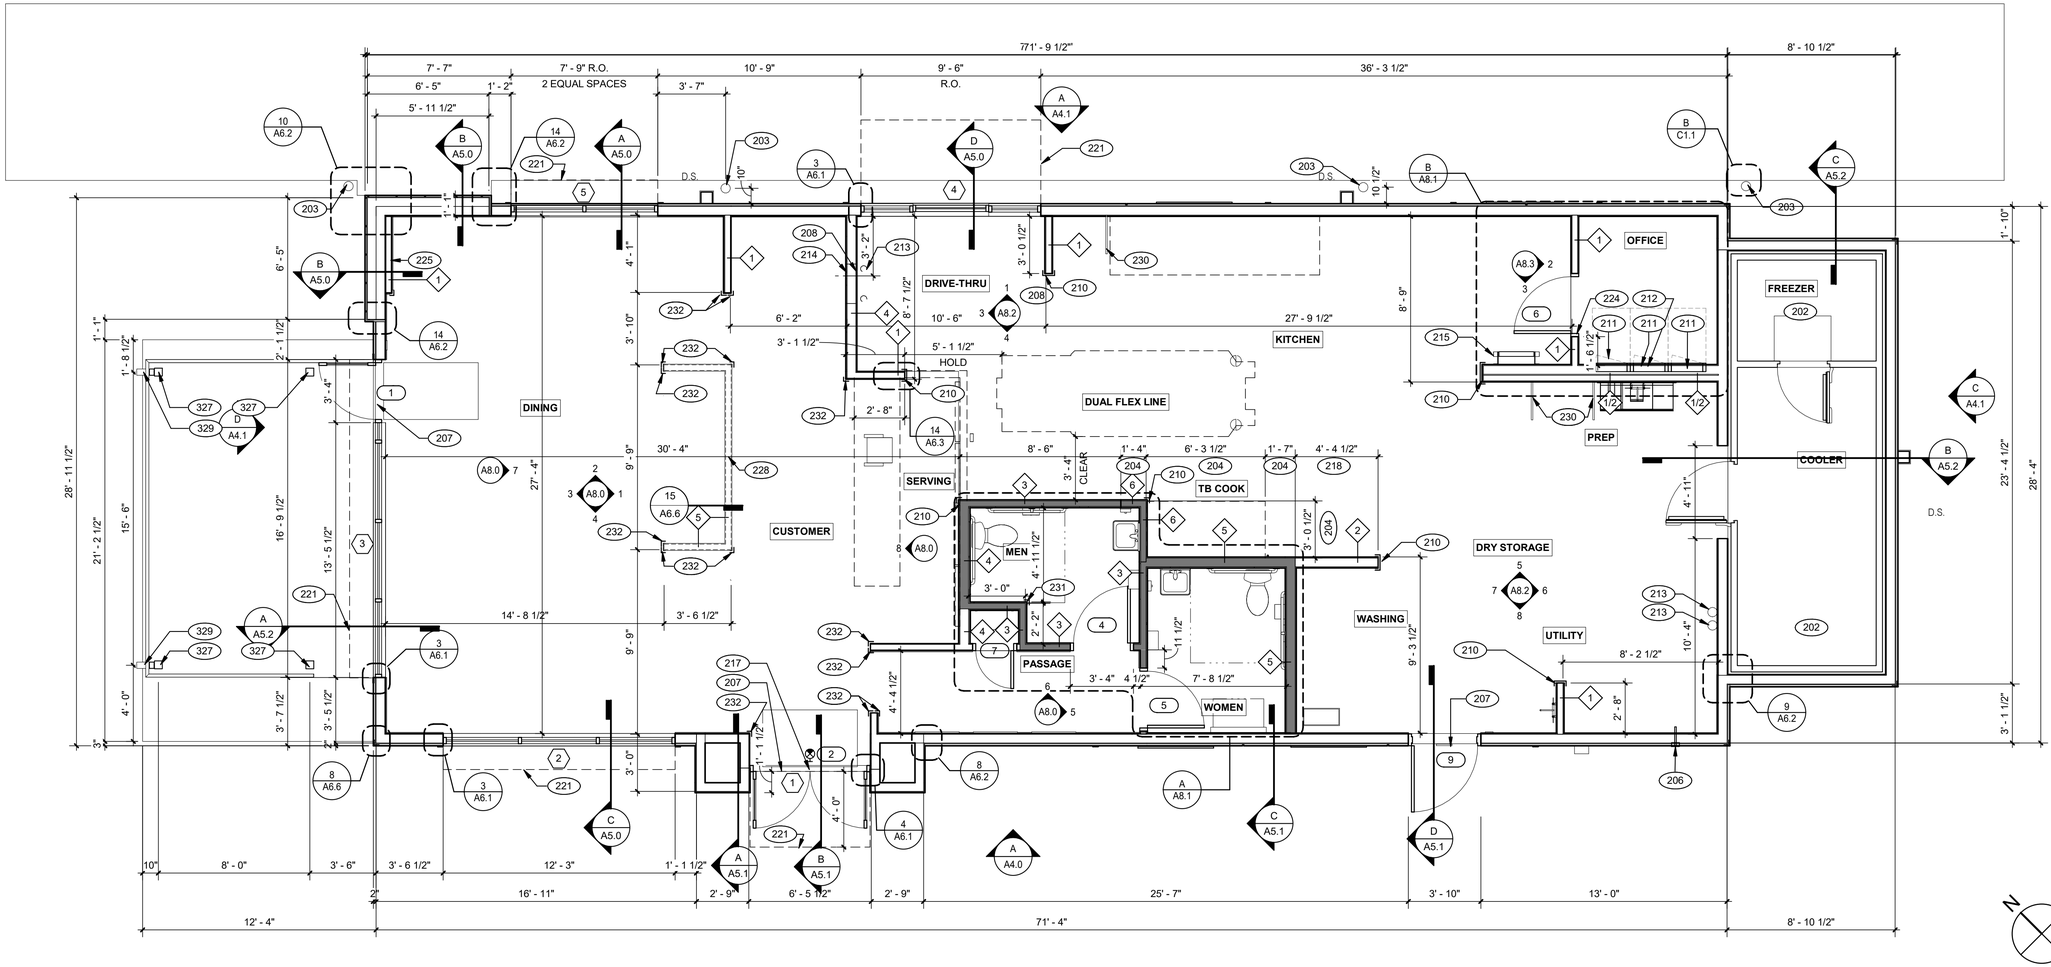

12 11 10 9 8 7 6 5 4 3 2 1

FLOOR PLAN 1/4" = 1'-0" **1**

TYPICAL EXTERIOR WALL:
2X6 WD STUDS AT 16" O.C. W/ SHEATHING AS SCHEDULED (SEE STRUCT. DWGS.) AND R-13 KRAFT-FACED FIBERGLASS BATT INSULATION U.O.N. GC SHALL PROVIDE WATER PROOFING MEMBRANE AND FULL HEIGHT BRICK VENEER

TYPICAL INTERIOR WALL:
WD STUDS AT 16" O.C. AS INDICATED

1 2X4 WOOD STUDS

2 2X6 WOOD STUDS

DASHED LINE INDICATES INTERIOR SUBSTRATE LOCATION.

INTERIOR SOUND-RATED WALL:
TYPICAL INTERIOR WALL W/ 3-1/2" UNFACED FIBERGLASS BATT INSULATION.

3 2X4 WOOD STUDS
4 2X6 WOOD STUDS
5 5 1/2" 18 GA. METAL STUDS@16" O.C.
6 3 5/8" 18 GA. METAL STUDS@16" O.C.

HOODWALL:
PANEL (BY G.C.) BEHIND HOOD. EXTEND MIN. 18" BEYOND END OF HOOD. REFER TO DETAIL 2/M3.0 FOR EXTENT OF S.S. PANEL.

LOW WALL:
2X4 WD STUDS AT 16" O.C. AS SCHEDULED (SEE DETAIL 18/A6.5)

7 2X4 WOOD STUDS

WALL HEIGHTS:
ALL INTERIOR NON-BEARING WALLS GO TO BOTTOM OF TRUSS, U.O.N. REFER TO STRUCTURE.

WALL SUBSTRATES:
- DINING ROOM:
1/2" GYPSUM WALLBOARD FROM FLOOR SLAB TO 6" ABOVE CEILING HEIGHT U.O.N. SEE 6 & 8/A6.3 (NOTE: THE CEMENT BOARD SPECIFICATION IS DESIGNED TO ALLOW THE G.C. FLEXIBILITY.)
- KITCHEN WALLS AND DINING ROOM CLOSET:
1/2" CEMENT WALLBOARD FROM T.O. SLAB T.O. 12" A.F.F. AT 12" A.F.F., USE 1/2" CDX PLYWOOD W/FRP SURFACE FINISH TO 6" ABOVE CEILING HEIGHT U.O.N. IF DOUBLE SIDE SHEAR WALL PLYWD IS SPECIFIED THE PLYWOOD SHALL BE CONTINUOUS FROM SILL PLATE TO TOP PLATE. SEE 3&16/A6.3.
- RESTROOM WALLS:
5/8" CEMENT WALLBOARD FROM T.O. SLAB OR T.O. CONCRETE CURB TO 48" A.F.F., WITH 5/8" HI-IMPACT BRAND XP WALLBOARD, TYPE X CORE FROM T.O. CEMENT BOARD TO 6" ABOVE CEILING HEIGHT U.O.N. NO SUBSTITUTIONS ALLOWED. FINISH AS SCHEDULED. 7/A6.3
- ALL OTHER FRAME WALL CONDITIONS:
1/2" CEMENT WALLBOARD FROM T.O. SLAB OR T.O. CONCRETE CURB TO 48" A.F.F., WITH 1/2" GYPSUM WALLBOARD FROM T.O. CEMENT BOARD TO 6" ABOVE CEILING HEIGHT U.O.N. FINISH AS SCHEDULE

WALL LEGEND **E**

DIMENSIONS:
A. ALL DIMENSIONS ARE TO FACE OF STUD U.O.N. REFER TO FOUNDATION PLAN FOR FACE OF CONC. DIMENSIONS.
B. DIMENSIONS NOTED AS "CLEAR" OR "HOLD" ARE MIN. REQUIRED. NET CLEARANCE FROM FACE OF WALL / WAINSCOT FINISH. VERIFY FINAL EQUIPMENT SIZES W/ VENDOR PRIOR TO INT. WALL FRAMING.

WINDOWS / DOORS:
A. SEE SHEET A1.1 FOR WINDOW TYPES AND DOOR SCHEDULE.
B. ALL DOOR AND WINDOW OPENING DIMENSIONS ARE TO ROUGH OPENING.

FINISH SUBSTRATES:
A. PROVIDE 1/2" THICK CEMENTITOUS BD. FROM FLOOR SLAB TO 12" A.F.F. MIN. IN LIEU OF GYP. BD. AT ALL WALLS EXCEPT SHEARWALL SURFACES, U.O.N.
B. ALL JOINTS, GAPS OR SPACES LEADING TO ALL HOLLOW OR INACCESSIBLE SPACES SHALL BE SEALED WITH "NSF INTERNATIONAL" APPROVED SEALANTS.
C. ALL BACK OF HOUSE AND OFFICE WALLS SHALL HAVE 1/2" CDX PLYWOOD SUBSTRATE, U.O.N.
D. PROVIDE 1/2" THICK CEMENTITIOUS BD. FROM SLAB TO BOT. OF TRUSSES @ METAL STUDS.

DECOR:
A. SEE A2.0 FOR SEATING PLAN AND DETAILS.
B. SEE A7.0 FOR FLOOR FINISHES.
C. SEE A8.0 - A8.3 FOR WALL FINISHES.
D. SEE A7.1 FOR CEILING FINISHES.

GENERAL:
A. PROVIDE THREE FIRE EXTINGUISHERS - (2) 10 lb. BC AND (1) 10 lb. ABC - TO COMPLY WITH LOCAL FIRE CODE. LOCATE PER DIRECTION OF FIRE MARSHALL OR LOCAL AUTHORIZING AGENT. FOR ADDITIONAL INFORMATION SEE SHEET A2.0
B. DRAWINGS ARE BASED UPON WOOD FRAMING. UTILIZATION OF METAL STUDS ON NON-BEARING INTERIOR PARTITONS, BULKHEADS AND SOFFITS IS ACCEPTABLE.

FLOOR PLAN NOTES **D**

202 NO FRP BEHIND W-059 WALK-IN COOLER/FREEZER.
203 PIPE BOLLARD. REFER TO DETAIL 8/C1.0.
204 HOOD WALL, SEE WALL LEGEND.
206 CO2 FILL BOX LOCATION; REFER TO DETAIL 20/A6.1.
207 TILE TO METAL THRESHOLD; REFER TO SHEET A.1 FOR DOOR TYPE.
208 KEEP CLEAR FOR UTILITIES & SYRUP LINES.
210 S.S. CORNER GUARD/WALL CAP [TM-2], TYP. ALL CORNERS IN BACK OF HOUSE FROM REAR WALL TO THE KITCHEN SIDE OF THE SERVICE COUNTER.
211 ELECTRICAL PANELS RECESSED IN 2X6 WALL.
212 LIGHTING CONTROL PANEL SURFACE MOUNTED. REFER TO ELECTRICAL DRAWINGS.
213 SYRUP LINE CHASE (ABOVE) REFER TO 10 AND 11/A6.4.
214 14"x14" HORIZONTAL OPENING FOR SYRUP TUBES. COORDINATE WALL PENETRATION WITH COUNTER INSTALLER. SEAL CHASE TO COUNTER. REFER TO DETAIL 8/A6.4
215 ROOF LADDER. SEE DETAIL 4/A6.0
217 REMOVABLE ASTRAGAL FROM INSIDE ONLY.
218 OMIT SOUND INSULATION THIS SECTION OF WALL.
221 LINE OF CANOPY ABOVE.
224 CASED OPENING, REFER TO DETAIL.
225 FUR OUT WALL AS INDICATED WITH 2X4 WOOD STUDS AT 16" O.C.
228 LOW WALL, BY G.C.
230 STAINLESS STEEL SPLASH GUARD. REFER TO DETAIL 9/A6.3
231 CORNER GUARD TILE SCHLUTER; REFER TO DETAIL 17/A6.3.
232 CORNER GUARD, BLACK, BY FURNITURE VENDOR

KEY NOTES **B**

national restaurant designers
NRD ARCHITECTS & ENGINEERS
7208 Ace Blvd. 2nd Floor Raleigh NC 27617
phone: 919.544.0087 fax: 919.544.9339
A Division of LMHT Associates

BRYAN L. JONES REGISTERED ARCHITECT No. 9852 SOUTH CAROLINA
05.19.22
STATE OF SOUTH CAROLINA LMHT ASSOCIATES, P.A. Morrisville, NC No. C84006 REGISTERED ARCHITECTS

DATE	REMARKS

CONTRACT DATE: 03/31/2022
BUILDING TYPE: END. MED 40
PLAN VERSION: SEPT. 2021
BRAND DESIGNER:
SITE NUMBER: 315669
ENTITY NUMBER: 458169
PA/PM: CNW/MP
DRAWN BY.: CNW
JOB NO.: 22204

ENDEAVOR 2.0
SPEARS CREEK CHURCH RD (BY LIBERTY RIDGE DRIVE)
SOUTH CAROLINA 29229

ENDEAVOR 2.0
FLOOR PLAN

A1.0

PLOT DATE: 5/18/2022 2:20:43 PM

PROJECT #22204

C:\Users\cwood\Documents\22204 Spears Creek_CWoodMP62V.rvt

CAUTION: IF THIS SHEET IS NOT 22"x34" IT IS A REDUCED PRINT